



Global-Mark Pty Ltd,  
Suite 4.07, 32 Delhi  
Road, North Ryde NSW  
2113, Australia

Tel: +61 (0)2 9886 0222  
- [www.Global-Mark.com.au](http://www.Global-Mark.com.au)

**Certificate Holder:**  
KMEW Co. Ltd.,  
Crystal Tower 13F, 1-2-  
27, Shiromi, Chuo-ku,  
Osaka-shi, Osaka-fu,  
Japan  
Tel: +81-6-6945-8123,  
<http://www.kmew.co.jp/CERA/FACADE/index.html>

# Certificate of Conformity

Certificate number: CM 30074 Rev 5

THIS IS TO CERTIFY THAT


## KMEW CERA FAÇADE Panels

<b>Type and/or use of product:</b> Panel for external wall lining of timber or cold-formed steel framed residential buildings		<b>Description of product:</b> Ceramic coated, fibre-reinforced cementitious panels used as external wall cladding. The CERA FAÇADE system is a ventilated cavity-based cladding system for use on timber or steel framed residential construction.		
<b>COMPLIES WITH THE FOLLOWING BCA PROVISIONS AND STATE OR TERRITORY VARIATION(S)</b>			<b>BCA 2022</b>	
	<b>Volume One</b>	<b>Volume Two and Housing Provisions (HP)</b>		
<b>Performance Requirement(s)</b>	<b>B1P1</b>	Structural reliability	<b>H1P1</b>	Structural stability and resistance
	<b>B1P2</b>	Structural resistance		
	<b>F3P1</b>	Weatherproofing	<b>H2P2</b>	Weatherproofing
	<b>F1P4</b>	Rising damp	<b>H2P3</b>	Rising damp
<b>Deemed-to-Satisfy Provision(s):</b>	<b>C2D10(6)(d)</b>	Non-combustible building elements	<b>H3D2(1)(d)</b>	Fire hazard properties and non-combustible building elements
	<b>F8D3</b>	Condensation management – external wall construction	<b>HP 7.5.3</b>	Wall cladding boards

**Scope of certification:** The CodeMark Scheme is a building product certification scheme. The rules of the Scheme are available at the ABCB website [www.abcb.gov.au](http://www.abcb.gov.au). This Certificate of Conformity is to confirm that the relevant requirements of the Building Code of Australia (BCA) as claimed against have been met. The responsibility for the product performance and its fitness for the intended use remain with the certificate holder. The certification is not transferrable to a manufacturer not listed on Appendix A of this certificate.

**Disclaimer:** The Scheme Owner, Scheme Administrator and Scheme Accreditation Body do not make any representations, warranties or guarantees, and accept no legal liability whatsoever arising from or connected to, the accuracy, reliability, currency or completeness of any material contained within this certificate; and the Scheme Owner, Scheme Administrator and Scheme Accreditation Body disclaim to the extent permitted by law, all liability (including negligence) for claims of losses, expenses, damages and costs arising as a result of the use of the product(s) referred to in this certificate. The purpose of Global-Mark **construction site audits** is to confirm the practicability of installing the product; and to confirm the appropriateness and accuracy of installation instructions. In placing the **CodeMark mark** on the product/system, the certificate holder makes a declaration of compliance with the certification standard(s) and confirms that the product is identical to the product certified herein. In issuing this Certificate of Approval Global-Mark has relied on the **expertise of external bodies** (laboratories, and technical experts).

  
**Herve Michoux**  
Global-Mark Managing Director

  
**Peter Gardner**  
Unrestricted Building Certifier

**Date of issue: 14/06/2024**

**Date of expiry: 28/03/2025**



State or territory variation(s):	<b>G5D3</b>	Construction in bushfire prone areas – Protection – residential buildings	<b>HP 10.8.1</b>	Condensation management – external wall construction
	<b>G5D4</b>	Construction in bushfire prone areas – Protection – certain Class 9 buildings	<b>H7D4</b>	Construction in bushfire prone areas
	<b>J4D6</b>	Energy efficiency - Walls and glazing	<b>HP 13.2.5</b>	Energy Efficiency – Building Fabric – External Walls
	<b>SA F1P4</b>	<b>Rising damp</b>	<b>NSW H2P3</b>	Rising damp
			<b>SA H2P3</b>	Rising damp
	<b>NSW G5D3</b>	Construction in bushfire prone areas	<b>NSW H7D4</b>	Bushfire Areas – Acceptable construction manuals
	<b>NSW G5D4</b>	Construction in bushfire prone areas		
	<b>VIC G5D4</b>	Construction in bushfire prone areas		
	<b>NSW Section J (NCC 2019 NSW J(A)1.2)</b>	Compliance with BCA provisions	<b>HP NT 13.2.5</b>	Energy Efficiency -Building Fabric – External walls
	<b>NSW J4D6</b>	Energy Efficiency – Walls and Glazing	<b>HP NSW 13.2.5</b>	Energy Efficiency – Building Fabric – External Walls
			<b>NSW H6 (NCC 2019 A1 3.12.1.4)</b>	Energy Efficiency – Building Fabric – External Walls
<b>Tas Section J (NCC 2019 A1 Volume 1 Section J)</b>	Energy Efficiency (Class 2 & 4 only)	<b>HP Tas 13.2 (NCC 2019 A1 P2.6.1)</b>	Energy Efficiency	
<b>SUBJECT TO THE FOLLOWING LIMITATIONS AND CONDITIONS AND THE PRODUCT TECHNICAL DATA IN APPENDIX A AND EVALUATION STATEMENTS IN APPENDIX B</b>				
<b>Limitations and conditions:</b>				
<b>Volume 1 B1P1 &amp; Volume 2 H1P1</b>				Unrestricted
Structural resistance in respect of wind actions only:				
<ul style="list-style-type: none"> <li>a. In accordance with AS 4055:2021 for non-cyclonic wind classes N1, N2 and N3 only; or,</li> <li>b. In accordance with AS/NZS 1170.2:2021 for ultimate strength wind pressures not exceeding those specified in Table 1.</li> </ul>				
<b>Volume 1 – F8D3 &amp; Volume 2 Housing Provisions – 10.8.1</b>				Class 1 building, sole-occupancy unit of a Class 2 building and Class 4 part of a building
A pliable building membrane or sarking type material complying with AS 4200.1:2017 (incorporating Amendment No.1) must be installed in accordance with AS 4200.2:2017 (incorporating Amendment Nos.1 and 2) on the exterior side of the primary insulation layer of an external wall, and it must have a vapour permeance of not less than:				

<p>a. 0.143 µg/N-s in climate zones 4 and 5; and b. 1.140 µg/N-s in climate zones 6, 7 and 8.</p>	
<p><b>Volume 1 – G5D3</b> In designated Bushfire prone areas, when the building is constructed in accordance with AS3959:2018 including Amendments 1 &amp; 2, KMEW Cera Facade Panels are permitted for use in buildings subject to Bushfire Attack Level up to &amp; including BAL-40.</p>	<p>Class 2, 3 and Class 10a building or decks immediately adjacent or connected to Class 2 or 3 building</p>
<p><b>Volume 2 – H7D4</b> In designated Bushfire prone areas, when the building is constructed in accordance with AS3959:2018 including Amendments 1 &amp; 2, or NASH Standard – Steel Framed Construction in Bushfire Areas, KMEW Cera Facade Panels are permitted for use in buildings subject to Bushfire Attack Level up to &amp; including BAL-40.</p>	<p>Class 1 &amp; 10a building or deck associated with a Class 1 building</p>
<p><b>Volume 1 – G5D4</b> In designated bushfire prone areas when the building is constructed in accordance with Specification 43, KMEW Cera Facade Panels are permitted for use only in buildings subject to Bushfire Attack Level not exceeding BAL-12.5. Construction in BAL-19, BAL-29, BAL-40 and BAL-FZ fall outside the scope of application of the clause.</p>	<p>Class 9a, 9b, 9c and Class 10a buildings or decks immediately adjacent or connected to Class 9a, 9b or 9c buildings</p>
<p><b>Volume 1 – NSW G5D3</b> In designated bushfire prone areas subject to Bushfire Attack Levels BAL-LOW, BAL-12.5, BAL-19 and BAL-29, determined in accordance with the Planning for Bush Fire Protection 2019 including addendum November 2022, when the building is constructed in accordance with AS3959: 2018 including Amendments 1 &amp; 2 except as modified by Planning for Bush Fire Protection 2019 including addendum November 2022, KMEW Cera Facade Panels are permitted for use. The compliance assessment of the certified system is limited to sections 7.5 and 8.3.2 of the Planning for Bush Fire Protection 2019 including addendum November 2022. Site specific conditions arising from:  <ul style="list-style-type: none"> <li>- the development consent following consultation with the NSW Rural Fire Service under section 4.14 of the Environmental Planning and Assessment Act 1979 if required, or</li> <li>- the development consent with a bushfire safety authority issued under section 100B of the Rural Fires Act 1997 for the purposes of integrated development</li> </ul>           have not been considered for the compliance assessment.             The Planning for Bush Fire Protection 2019 including addendum November 2022 requires a performance-based application in bushfire prone areas subject to Bushfire Attack BAL-40 &amp; BAL-FZ. Construction in NSW’s bushfire prone areas subject to Bushfire Attack BAL-40 &amp; BAL-FZ have not been considered in this assessment.</p>	<p>Class 2, 3, Class 4 part of a building &amp; 10a building or deck immediately adjacent or connected to building of Class 2, 3 or Class 4 part of a building</p>
<p><b>Volume 2 – NSW H7D4 (2)</b> In designated bushfire prone areas subject to Bushfire Attack Levels BAL-LOW, BAL-12.5, BAL-19 and BAL-29, determined in accordance with the Planning for Bush Fire Protection 2019 including addendum November 2022, when the building is constructed in accordance with:</p>	<p>Class 1 &amp; 10a building or deck associated with a Class 1 building</p>

<ul style="list-style-type: none"> <li>- AS3959: 2018 including Amendments 1 &amp; 2 except as modified by Planning for Bush Fire Protection 2019 including addendum November 2022, or</li> <li>- NASH Standard – Steel Framed Construction in Bushfire Area Except as amended by the Planning for Bush Fire protection 2019 including addendum November 2022,</li> </ul> <p>KMEW Cera Facade Panels are permitted for use.</p> <p>The compliance assessment of the certified system is limited to sections 7.5 and 8.3.2 of the Planning for Bush Fire Protection 2019 including addendum November 2022.</p> <p>Site specific conditions arising from:</p> <ul style="list-style-type: none"> <li>- the development consent following consultation with the NSW Rural Fire Service under section 4.14 of the Environmental Planning and Assessment Act 1979 if required, or</li> <li>- the development consent with a bushfire safety authority issued under section 100B of the Rural Fires Act 1997 for the purposes of integrated development</li> </ul> <p>have not been considered for the compliance assessment.</p> <p>The Planning for Bush Fire Protection 2019 including addendum November 2022 requires a performance-based application in bushfire prone areas subject to Bushfire Attack BAL-40 &amp; BAL-FZ. Construction in NSW’s bushfire prone areas subject to Bushfire Attack BAL-40 &amp; BAL-FZ have not been considered in this assessment.</p>	
<p><b>Volume 1 – NSW G5D4</b></p> <p>In designated bushfire prone areas subject to Bushfire Attack Levels not exceeding BAL-12.5, determined in accordance with the Planning for Bush Fire Protection 2019 including addendum November 2022, KMEW Cera Facade Panels are permitted for use when the building is constructed in accordance with:</p> <ol style="list-style-type: none"> <li>a) For class 9 buildings, Specification 43 except as modified by Planning for Bush Fire Protection 2019 including addendum November 2022, or</li> <li>b) For class 10a buildings or decks, AS3959: 2018 including Amendments 1 &amp; 2 except as modified by Planning for Bush Fire Protection 2019 including addendum November 2022 and S43C13,</li> </ol> <p>The compliance assessment of the certified system is limited to sections 7.5 and 8.3.2 of Planning for Bush Fire Protection 2019 including addendum November 2022.</p> <p>Site specific conditions arising from the development consent with a bushfire safety authority issued under section 100B of the Rural Fires Act 1997 for the purposes of integrated development are site specific and have not been considered for the compliance assessment.</p> <p>Construction in BAL-19, BAL-29, BAL-40 and BAL-FZ fall outside the scope of application of the clause.</p>	<p>Class 9 building that is a special fire protection purpose; and a Class 10a building or deck immediately adjacent or connected to such building</p>
<p><b>Volume 1 – VIC G5D4</b></p> <p>In designated bushfire prone areas when the building is constructed in accordance with Specification 43, KMEW Cera Facade Panels are permitted for use only in buildings subject to Bushfire Attack Level not exceeding BAL-12.5.</p> <p>Construction in BAL-19, BAL-29, BAL-40 and BAL-FZ fall outside the scope of application of the clause.</p>	<p>Class 4 part of a building, Class 9a, 9b, 9c and Class 10a buildings or decks immediately adjacent or connected to Class 4 parts, Class 9a, 9b or 9c buildings</p>

## APPENDIX A – PRODUCT TECHNICAL DATA

### A1 Type and intended use of product

See type and/or use of product on page 1

### A2 Description of product

See description of product on page 1.

CERA FAÇADE Panels are pre-finished extruded fibre-reinforced cement wall claddings, 3030 mm in length, 466 mm in width (for an effective cover of 455 mm) and 16 mm or 18 mm in thickness. CERA FAÇADE Panels are installed either horizontally or vertically to timber or cold-formed steel wall frame studs with proprietary brackets and fasteners providing a nominal 15 mm cavity.

Figure 1 on page 5 shows the typical construction configuration for horizontal panel layout where the B1015 clips are fixed directly to the studs. Figure 2 on page 6 shows the typical construction configuration for vertical panel layout where the B10115 clips are fixed to minimum 30 mm thick horizontal furring strips that are fixed to the studs.

### A3 Product specification

Product selection, and incorporation into the building design, shall be made by a professional Architect or Engineer or other appropriately qualified person who:

- Has qualifications and experience acceptable to the relevant approval authorities; and
- Has ready access to KMEW CERA FAÇADE for Steel Frame - Design/Installation Manual for Australia, 21 September 2022 and KMEW CERA FAÇADE for Timber Frame - Design/Installation Manual for Australia, 1 September 2022.

The product is classified as a Type A Category 3 fibre cement board in accordance with AS/NZS 2908.2:2000.

Refer to Table 1 on page 6 for CERA FAÇADE Panel fixing requirements by Wind Class to AS 4055:2021 or corresponding ultimate strength wind pressure.

Refer to Table 2 on page 6 for CERA FAÇADE wall system R-Values.

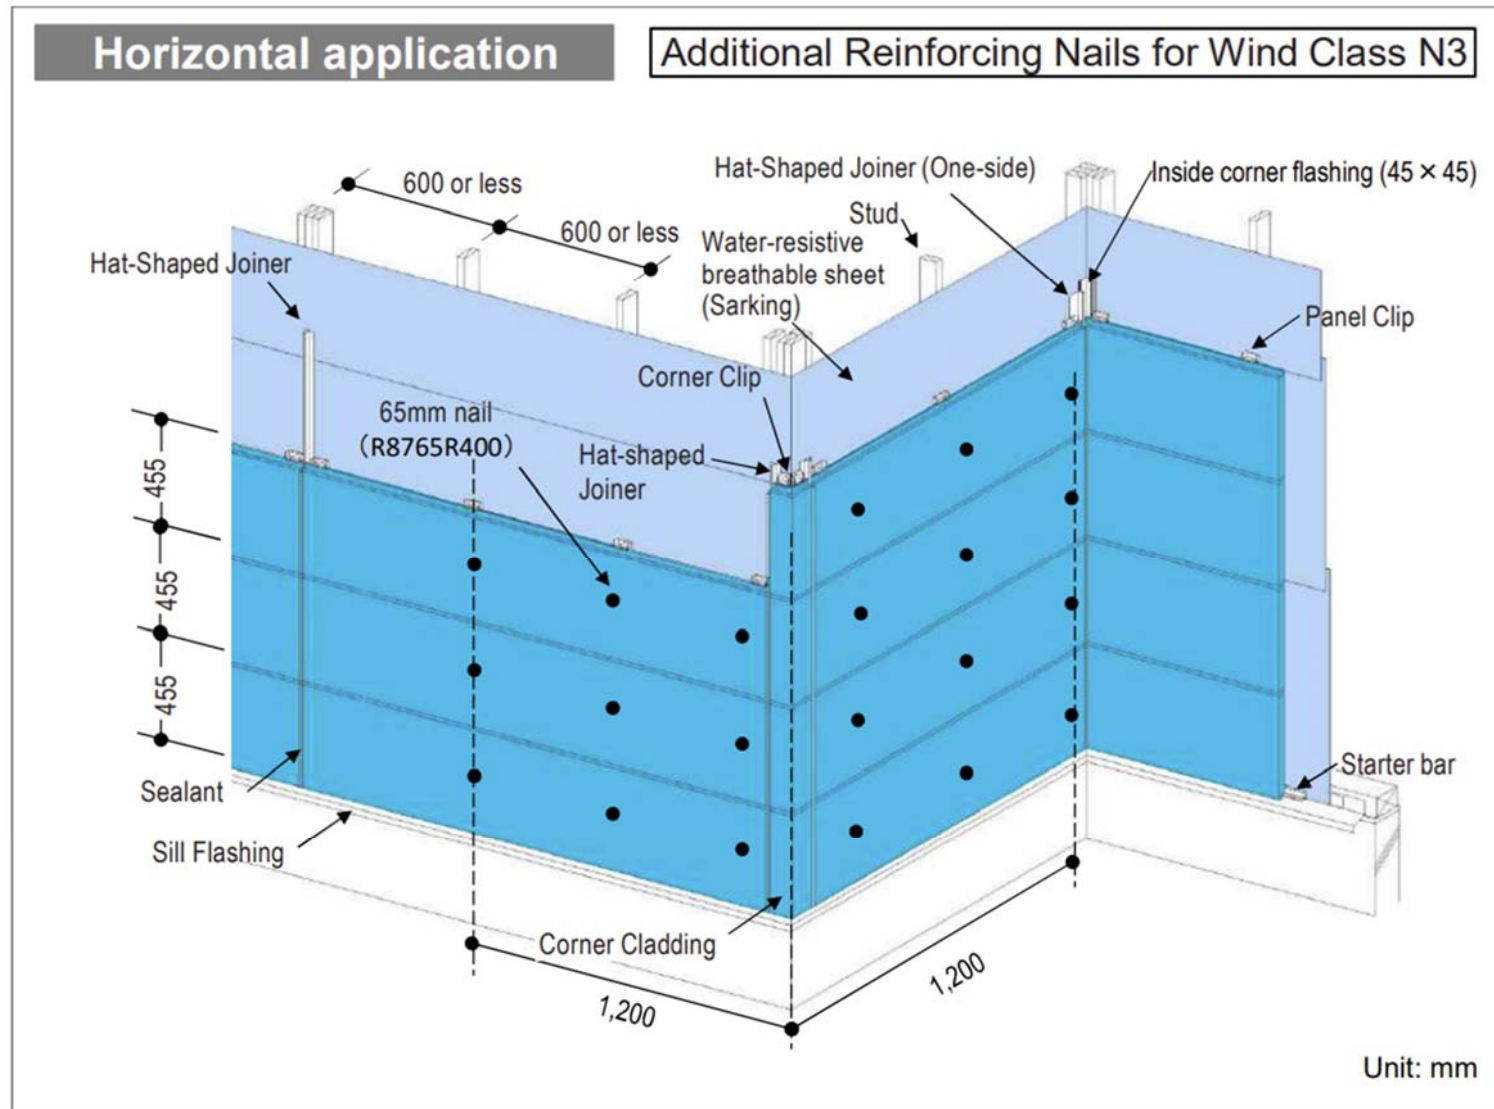


Figure 1

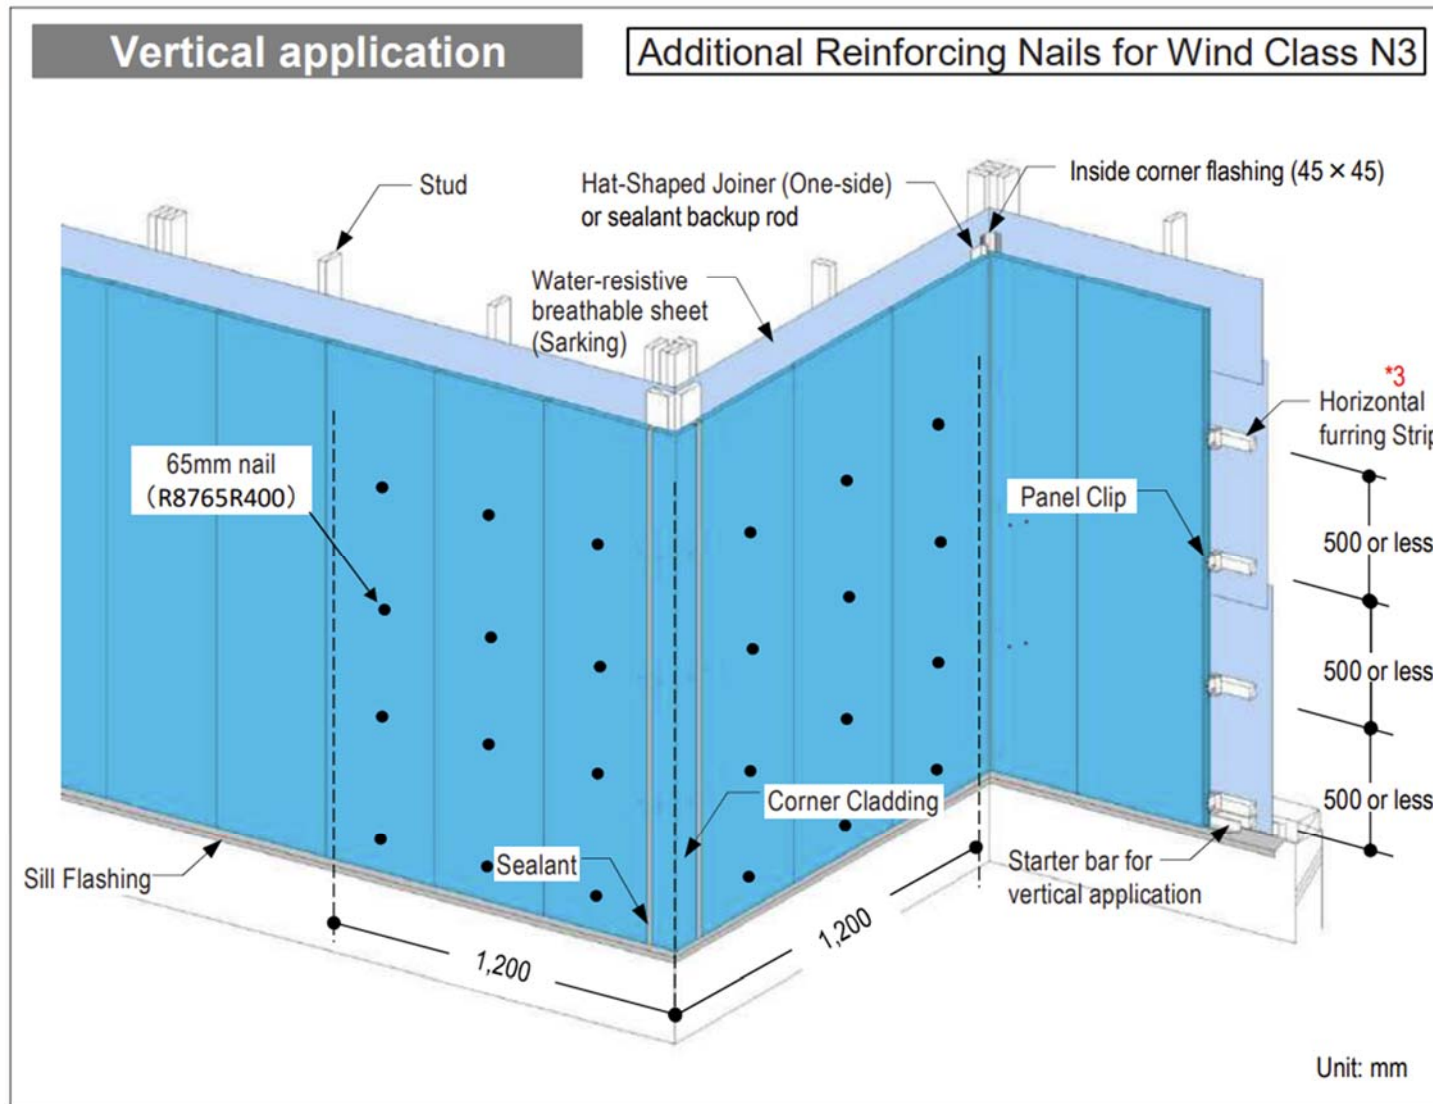


Figure 2

**Table 1: CERA FAÇADE Panel Fixing Requirement**

Wind Class to AS 4055:2021	Applicable Ultimate Strength Wind Pressure		Minimum CERA FAÇADE Panel Fixing Requirement	
	General Areas	Corner Zones	General Areas	Corner Zones
N1w	+0.62 kPa / -0.53 kPa	-0.94 kPa	Panel clip at 600 mm ctrs.	Panel clip at 600 mm ctrs.
N2w	+0.86 kPa / -0.74 kPa	-1.30 kPa	Panel clip at 600 mm ctrs.	Panel clip at 600 mm ctrs.
N3w	+1.35 kPa / -1.16 kPa	-2.03 kPa	Panel clip at 600 mm ctrs.	Panel clip + face fix at 600 mm ctrs.

**Notes to Table 1:**

1. Corner zone is within 1,200 mm of an external corner of a building.
2. Face fix is an additional mid width panel fixing to each stud with the following fasteners:
  - a. Timber frame – dia. 3 mm x 65 mm nail
  - b. Cold-formed steel frame – 50 mm countersunk head screw
3. For buildings outside the scope of AS 4055:2021, the specified ultimate strength wind pressure determined in accordance with AS/NZS 1170.2:2021 shall not be exceeded for the fixing method. In summary, the maximum capacity of the system is as follows:
  - a. Panel clip at 600 mm ctrs.: +1.35 kPa / -1.30 kPa
  - b. Panel clip + face fix at 600 mm ctrs.: +1.35 kPa / -2.03 kPa

**Table 2: Wall System R-Value – 16 mm CERA FAÇADE Panel**

Stud Cavity Width (mm)	Stud Cavity Added Insulation R-Value (m <sup>2</sup> K/W)	Wall System R-Value (m <sup>2</sup> K/W)	
		Winter	Summer
70	None	1.6	1.3
70	1.4	2.3	2.0
75	1.5	2.4	2.1
90	2.0	2.9	2.6

**Notes to Table 2:**

1. System R-Value includes air films and non-ventilated cavity air space in accordance with AS/NZS 4859.2:2018.
2. System R-Value does not consider effect of wall studs and other members in respect of effective wall area nor thermal bridging.
3. Minimum 10 mm thick plasterboard lining internal.
4. 15 mm cavity between CERA FAÇADE Panel and the stud frame.
5. R 0.2 m<sup>2</sup>K/W may be added to the system R-Value when the vapour barrier is reflective.





# Certificate of Conformity

## A4 Manufacturer and manufacturing plant(s)

KMEW IGA plants, manufacturing the “Neorock” and “Filtect” product series, known as “CERA FAÇADE” in the Australian market.

IGA Plant address: 410-1, Higashi-omachi, Mita-aza, Iga-City, Mie, 5108-0022, Japan

Ashikaga Plant address: 1009-1, Kishinome, Hakari-cho, Ashikaga, Tochigi, , 326-0327 Japan

## A5 Installation requirements

1. Product installation shall be carried out by a competent tradesperson under the direction of a Builder, both of whom have ready access to the KMEW CERA FAÇADE for Steel Frame - Design/Installation Manual for Australia, 21 September 2022; or KMEW CERA FAÇADE for Timber Frame - Design/Installation Manual for Australia, 1 September 2022 as applicable to the framing solution for the building.
2. The installer must complete, sign and send to the Certificate Holder a Certificate of Installation when installation is complete.

## A6 Other relevant technical data

Any referenced documents within the technical literature identified in Appendix A, A3 and Appendix A, A5.

## APPENDIX B – EVALUATION STATEMENTS

### B1 Evaluation methods

The following assessment methods have been used to determine compliance with NCC 2022:

Code Clause	Assessment Method(s)	Evidence of suitability	Evidence reference in B2
NCC Volume Two H1P1	NCC Volume Two A2G2(2)(a)	NCC Volume Two A5G3(1)(d) Report issued by an Accredited Testing Laboratory	Items 1, 2, 3, 4, 7, 10 and 11
		NCC Volume Two A5G3(1)(e) Certificate or report from a professional engineer or other appropriately qualified person	Items 5 and 6
		NCC Volume Two A5G3(1)(f) Another form of documentary evidence	Items 10 and 11
NCC Volume Two H2P2	NCC Volume Two A2G2(2)(a)	NCC Volume Two A5G3(1)(d) Report issued by an Accredited Testing Laboratory	Item 4
NCC Volume Two H2P3	NCC Volume Two A2G2(2)(a)	NCC Volume Two A5G3(1)(d) Report issued by an Accredited Testing Laboratory	Item 4
NCC Volume Two H3D2(1)(d)	NCC Volume Two A2G3(2)(a)	NCC Volume One A5G3(1)(d) Report issued by an Accredited Testing Laboratory	Items 10 and 11
		NCC Volume One A5G3(1)(f) Another form of documentary evidence	Items 8 and 9
Housing Provisions 7.5.3	NCC Volume Two A2G3(2)(a)	NCC Volume Two A5G3(1)(d) Report issued by an Accredited Testing Laboratory	Items 10 and 11
NCC Volume Two H7D4	NCC Volume Two A2G3(2)(a)	NCC Volume Two A5G3(1)(f) Another form of documentary evidence	Items 8 and 9
Housing Provisions 13.2.5	NCC Volume Two A2G3(2)(a)	NCC Volume Two A5G3(1)(f) Another form of documentary evidence	Items 8 and 9
Housing Provisions 10.8.1	NCC Volume Two A2G3(1)	NCC Volume Two A5G3(1)(d) Report issued by an Accredited Testing Laboratory	Items 10 and 11
NCC Volume One B1P1	NCC Volume One A2G2(2)(a)	NCC Volume One A5G3(1)(d) Report issued by an Accredited Testing Laboratory	Items 1, 2, 3, 4, 7, 10 and 11
		NCC Volume One A5G3(1)(e) Certificate or report from a professional engineer or other appropriately qualified person	Items 5 and 6
		NCC Volume One A5G3(1)(f) Another form of documentary evidence	Items 8 and 9
NCC Volume One B1P2	NCC Volume One A2G2(2)(a)	NCC Volume One A5G3(1)(d) Report issued by an Accredited Testing Laboratory	Items 1, 2, 3, 4, 7, 10 and 11
		NCC Volume One A5G3(1)(e) Certificate or report from a professional engineer or other appropriately qualified person	Items 5 and 6

		NCC Volume One A5G3(1)(f) Another form of documentary evidence	Items 8 and 9
NCC Volume One F3P1	NCC Volume One A2G2(2)(a)	NCC Volume One A5G3(1)(d) Report issued by an Accredited Testing Laboratory	Item 4
NCC Volume One F1P4	NCC Volume One A2G2(2)(a)	NCC Volume One A5G3(1)(d) Report issued by an Accredited Testing Laboratory	Item 4
NCC Volume One C2D10(6)(d)	NCC Volume One A2G3(2)(a)	NCC Volume One A5G3(1)(d) Report issued by an Accredited Testing Laboratory	Items 10 and 11
		NCC Volume One A5G3(1)(f) Another form of documentary evidence	Items 8 and 9
NCC Volume One F8D3	NCC Volume One A2G3(1)	NCC Volume One A5G3(1)(f) Another form of documentary evidence	Items 8 and 9
NCC Volume One G5D3	NCC Volume One A2G3(1)	NCC Volume One A5G3(1)(f) Another form of documentary evidence	Items 8 and 9
NCC Volume One G5D4	NCC Volume One A2G3(1)	NCC Volume One A5G3(1)(f) Another form of documentary evidence	Items 8 and 9
NCC Volume One J4D6	NCC Volume One A2G3(2)(a)	NCC Volume One A5G3(1)(f) Another form of documentary evidence	Items 8 and 9
NCC Volume Two NSW H2P3	NCC Volume Two A2G2(2)(a)	NCC Volume Two A5G3(1)(d) Report issued by an Accredited Testing Laboratory	Item 4
NCC Volume Two SA H2P3	NCC Volume Two A2G2(2)(a)	NCC Volume Two A5G3(1)(d) Report issued by an Accredited Testing Laboratory	Item 4
NCC Volume Two NSW H7D4	NCC Volume Two A2G3(3)(a)(i)	NCC Volume Two A5G3(1)(f) Another form of documentary evidence	Items 8 and 9
Housing Provisions NT 13.2.5	NCC Volume Two A2G3(2)(a)	NCC Volume Two A5G3(1)(f) Another form of documentary evidence	Items 8 and 9
Housing Provisions NSW 13.2.5	NCC Volume Two A2G3(2)(a)	NCC Volume Two A5G3(1)(f) Another form of documentary evidence	Items 8 and 9
Housing Provisions Tas 13.2 (NCC 2019 A1 P2.6.1)	NCC Volume Two A2G3(2)(a)	NCC Volume Two A5G3(1)(f) Another form of documentary evidence	Items 8 and 9
NCC Volume Two NSW H6 (NCC 2019 A1 3.12.1.4)	NCC Volume Two A2G3(2)(a)	NCC Volume Two A5G3(1)(f) Another form of documentary evidence	Items 8 and 9
NCC Volume One SA F1P4	NCC Volume One A2G2(2)(a)	NCC Volume One A5G3(1)(d) Report issued by an Accredited Testing Laboratory	Item 4
NCC Volume One NSW G5D3	NCC Volume One A2G3(1)	NCC Volume One A5G3(1)(f) Another form of documentary evidence	Items 8 and 9
NCC Volume One NSW G5D4	NCC Volume One A2G3(1)	NCC Volume One A5G3(1)(f) Another form of documentary evidence	Items 8 and 9
NCC Volume One VIC G5D4	NCC Volume One A2G3(1)	NCC Volume One A5G3(1)(f) Another form of documentary evidence	Items 8 and 9

NCC Volume One NSW Section J (NCC 2019 NSW J(A)1.2)	NCC Volume One A2G3(2)(a)	NCC Volume One A5G3(1)(f) Another form of documentary evidence	Items 8 and 9
NCC Volume One NSW J4D6	NCC Volume One A2G3(2)(a)	NCC Volume One A5G3(1)(f) Another form of documentary evidence	Items 8 and 9
NCC Volume One Tas Section J (NCC 2019 A1 Volume 1 Section J)	NCC Volume One A2G3(2)(a)	NCC Volume One A5G3(1)(f) Another form of documentary evidence	Items 8 and 9

## B2 Reports

The following reports have been used as evidence to determine compliance with NCC 2022:

Ref	Author	Reference	Date	Description	NATA Registration
1	BRANZ	ST0875/1	20/3/2012	Face load pressure box tests on KMEW Ceradir siding 14 mm solid core nail fixed over timber battens to timber studs – in accordance with AS 4040.2.	Via ilac-MRA IANZ Accreditation No. 918
2	BRANZ	ST0875/2.R1	19/6/2012	Face load pressure box tests on KMEW Neorock siding 16 mm thick hollow core clip and nail fixed to timber framing – in accordance with AS 4040.2.	Via ilac-MRA IANZ Accreditation No. 918
3	BRANZ	ST0875/3	20/3/2012	Face load pressure box tests on KMEW Neorock siding 16 mm thick hollow core which was clip fixed to timber framing – in accordance with AS 4040.2.	Via ilac-MRA IANZ Accreditation No. 918
4	BRANZ	Appraisal No. 783	27/3/2013	KMEW NEOROCK and CERADIR 16 mm Panels Cladding System	Via ilac-MRA IANZ Accreditation No. 918
5	Parametric Developments		13/4/2015	Preliminary Test Report – KMEW Ceradir Cladding fixed to steel framing - connection	Not applicable
6	Parametric Developments		14/9/2015	Preliminary Test Report – KMEW Ceradir Cladding fixed to steel framing – shear test	Not applicable
7	BRANZ	ST1110	15/3/2016	Face load testing for KMEW	Via ilac-MRA IANZ Accreditation No. 918
8	KMEW Co., Ltd.		21/09/2022	KMEW CERA FAÇADE for Steel Frame - Design/Installation Manual for Australia	Not applicable
9	KMEW Co., Ltd.		01/09/2022	KMEW CERA FAÇADE for Timber Frame - Design/Installation Manual for Australia	Not applicable
10	BRANZ	DC2251	28/06/2012	AS/NZS 2908.2 Testing of KMEW Ceradir Siding 14 mm Solid Core Board	Via ilac-MRA IANZ Accreditation No. 918
11	BRANZ	DC12569-001	17/06/2021	AS/NZS 2908.2 testing of KMEW NEOROCK 16 mm hollow core fibre cement board	Via ilac-MRA IANZ Accreditation No. 918

The Certificate Holder has chosen not to make the above identified evidence of compliance publicly available, due to the documents being considered commercial in confidence.